

SUBMITTAL

Job Name:

Purchaser:

Submitted To:

Construction:

Reference:

Approval:

Date:

Submitted By:

Unit:

Drawing #:

US18CB2BEA

Indoor Accessories

Refrigerant Detection Sensor (RDS)	UALS01A
------------------------------------	---------



GE Appliances

Cassette Panel (Required)	GACCP01GA
Remote Controller (Ships with Panel)	WJ26X35396
Wired Controller (Optional)	GACT17B




Haier

Cassette Panel (Required)	QACCP01WA
Remote Controller (Ships with Panel)	WJ26X35394
Wired Controller (Optional)	QACT17B

Specifications

Cooling	Rated Cooling Capacity Btu/hr	18,000
Heating	Rated Heating Capacity Btu/hr	14,400
Power	Voltage, Cycle, Phase V/Hz/Phase	208-230/60/1
	Operating Voltage Range	187-253 VAC
Indoor Unit	Fan Speed Stages	5 + Auto
	Airflow CFM: Cooling (Turbo/High/Med/Low/Quiet)	458/425/387/345/302
	Motor Speed RPM: Cooling (Turbo/High/Med/Low/Quiet)	850/800/760/680/590
	Indoor Sound Level dB: Cooling (Turbo/High/Med/Low/Quiet)	45/42/40/36/32
	Airflow CFM: Heating (Turbo/High/Med/Low/Quiet)	479/441/387/345/302
	Motor Speed RPM: Heating (Turbo/High/Med/Low/Quiet)	850/800/760/680/590
	Indoor Sound Level dB: Heating (Turbo/High/Med/Low/Quiet)	45/42/40/36/32
	Chassis Dimension: HxWxD in (mm)	10 1/4 x 22 3/4 x 22 3/4 (260 x 575 x 575)
	Weight (Net/Ship)- lbs (kg)	32.41/47.4 (14.7/21.5)
	Drainpipe Size O.D. (in)	1*
	Condensate Pump Built-In	Yes
	Max. Drain-Lift Height in (mm)	47 1/4 (1200)
	WiFi**	Built-in
	Factory-Installed Refrigerant Detection Sensor (RDS)	No
	Refrigerant Detection Sensor (RDS) Compatible	Yes
Refrigerant Line	Panel Model	GACCP01GA / QACCP01WA
	Panel Dimension: HxWxD in (mm)	2 3/8 x 27 7/16 x 27 7/16 (60 x 620 x 620)
	Liquid Pipe O.D. (in)	1/4
	Suction Pipe O.D. (in)	1/2

US18CB2BEA

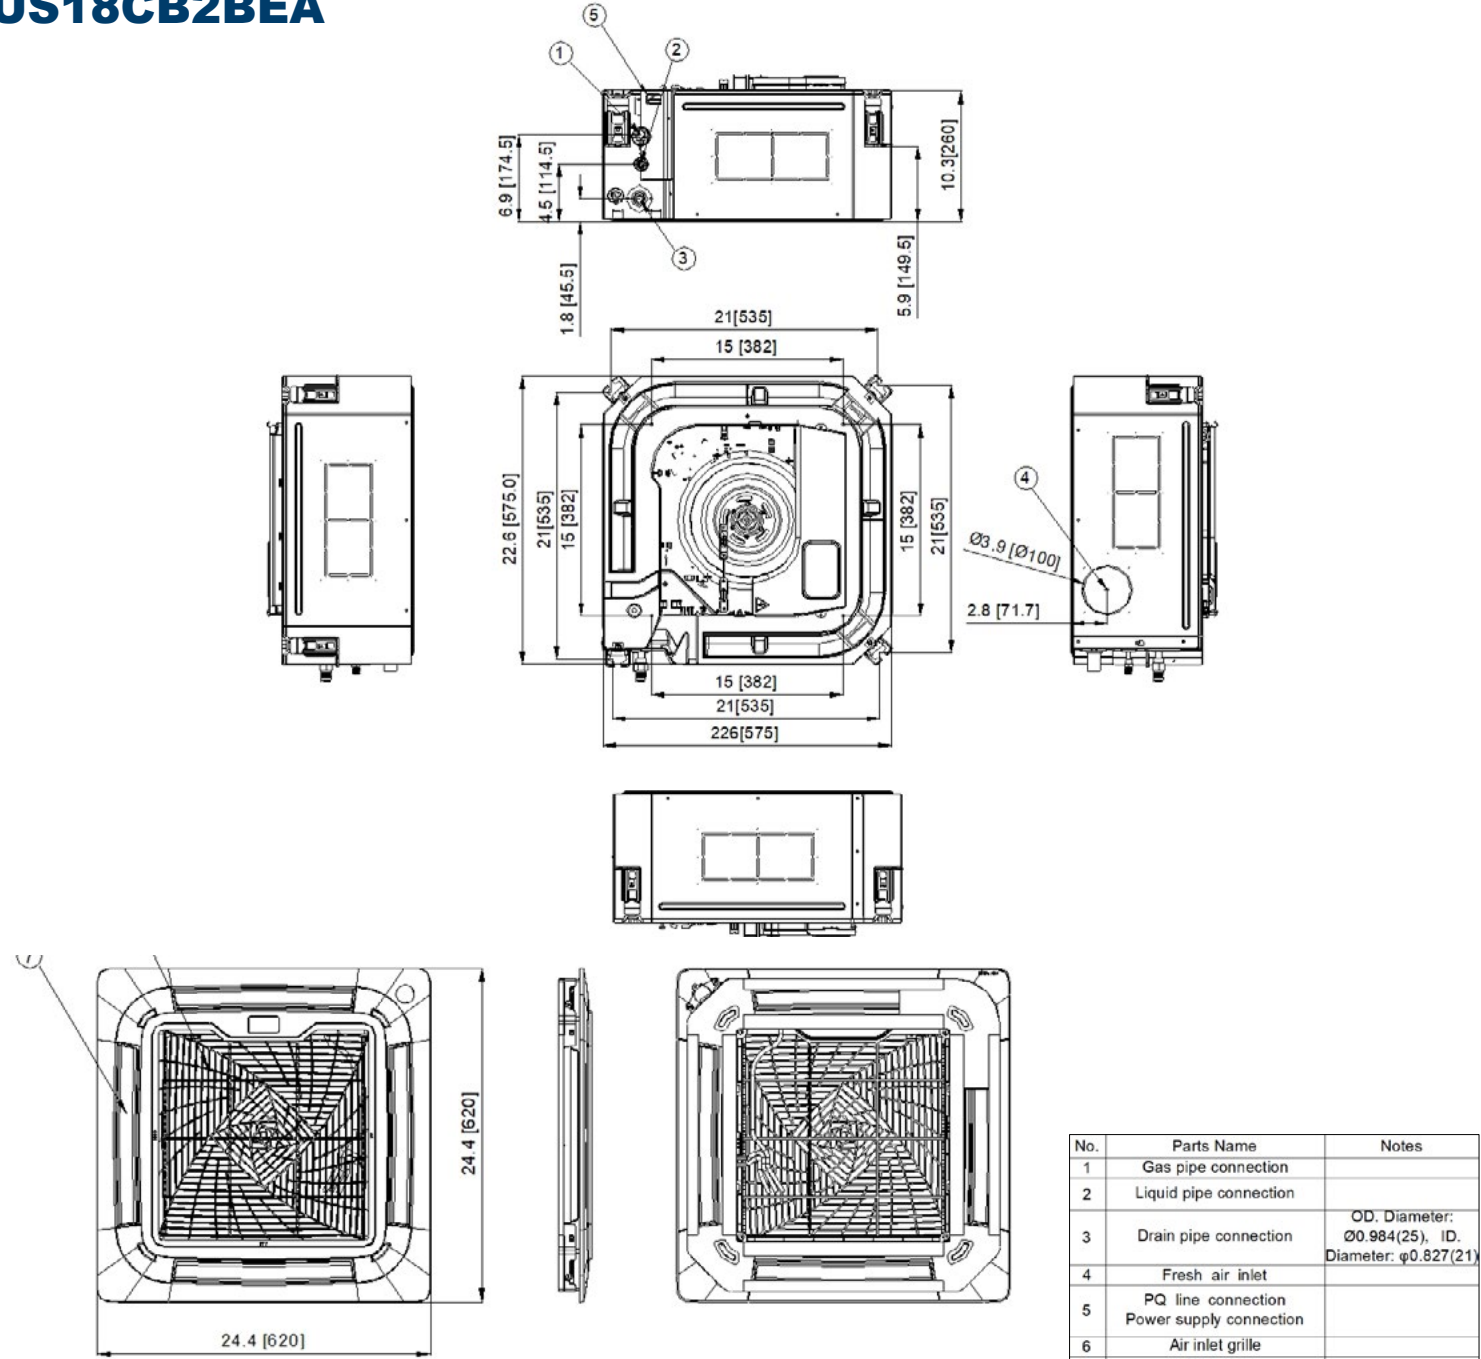

No.	Parts Name	Notes
1	Gas pipe connection	
2	Liquid pipe connection	
3	Drain pipe connection	OD: Diameter: Ø0.984(25), ID: Diameter: Ø0.827(21)
4	Fresh air inlet	
5	PQ line connection Power supply connection	
6	Air inlet grille	
7	Air outlet	

Note: Dimensions are shown in inches (millimeters)

SUBMITTAL REVISION HISTORY

03-31-25: Submittal release.